


## FREEZER SPECIFICATIONS

### CHECKED:

- \_\_\_ SIZE: 9'-9 3/8" x 7'-9 3/8" x 8'-0"
- \_\_\_ PANEL THICKNESS: 5 1/2" WALLS, & 5 1/2" CEILING
- \_\_\_ FLOOR PANEL THICKNESS: 4 5/8"
- \_\_\_ EXTERIOR FINISH: (01) 26 GA. STUCCO GALVANIZED
- \_\_\_ INTERIOR FINISH: (01) 26 GA. STUCCO GALVANIZED
- \_\_\_ INTERIOR FLOOR FINISH: (21) 0.050 ALUMINUM
- \_\_\_ CEILING TYPE: LAG DOWN
- \_\_\_ FLOOR TYPE: STANDARD FLOOR WITH WOOD SCREED
- \_\_\_ DOOR DESCRIPTION: 1 QTY 34" x 76 1/4" OVERLAP SELF-CLOSING DOOR  
4-SIDED GASKET W/ 4-SIDED HTD FRAME & HTD DOOR PLUG
- \_\_\_ ACCESSORIES:
  - \_\_\_ (1) VAPOR PROOF LIGHT 115V. (BULB NOT INCLUDED)
  - \_\_\_ (1) LIGHT SWITCH AND DIGITAL THERMOMETER 115V.
  - \_\_\_ (1) HEATED VENT K1825 115V.
- \_\_\_ NOTES:
  - \_\_\_ WOOD SCREED INSTALLED ON FLOOR IN THE FIELD.
  - \_\_\_ DOOR CAN BE INSTALLED WHERE ANY 47" PANEL OCCURS.

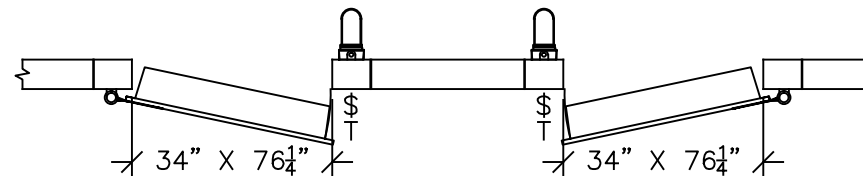

LEFT HAND SWING



RIGHT HAND SWING



NOTE: DOOR CAN BE PLACED WHERE ANY 47" PANEL OCCURS.

\*\*\* ATTENTION \*\*\* PLEASE SIGN

\_\_\_\_ ("BUYER") APPROVES IN ALL RESPECTS THE DRAWINGS PROVIDED BY CARROLL COOLERS ("SELLER") IN CONNECTION WITH THE SELLER'S QUOTE, CI-\_\_\_\_, DATED \_\_\_\_\_, 201\_\_\_\_ AND/OR THE BUYER'S PURCHASE ORDER, #\_\_\_\_, DATED \_\_\_\_\_, 201\_\_\_\_. THE BUYER ACKNOWLEDGES & CONFIRMS THAT THE AGREEMENT BETWEEN BUYER AND SELLER CONSISTS OF THE (i) DESCRIPTIONS AND QUANTITIES OF THE GOODS STATED ON SUCH PURCHASE ORDER, AND (ii) THE PRICES, DELIVERY DATES, AND TERMS & CONDITIONS STATED ON SUCH QUOTE. BUYER FURTHER ACKNOWLEDGES THAT SUCH TERMS & CONDITIONS SUPERSEDE AND REPLACE ANY AND ALL TERMS AND CONDITIONS APPEARING ON/IN THE BUYER'S PURCHASE ORDER FORM.

\*\*\* ATTENTION \*\*\* PLEASE SIGN & CHECK BOX

FAX TO CARROLL COOLERS AT (712) 792-6748

APPROVED AS DRAWN  
 APPROVED AS NOTED  
 REVISE AND RESUBMIT

\_\_\_\_\_  
SIGNATURE

\_\_\_\_\_  
PRINTED NAME

\_\_\_\_\_  
DATE

IT IS THE CUSTOMER'S RESPONSIBILITY TO VERIFY ALL ITEMS ON THE APPROVAL. ALL NECESSARY REVISIONS MUST BE NOTED ON THIS DRAWING. FINAL DRAWING WILL BE PRODUCED USING A SIGNED APPROVAL DWG.

**IMPORTANT!**  
THIS WALK-IN IS DESIGNED TO SUPPORT ONLY ITS OWN WEIGHT. STORAGE ON TOP, MOUNTING TO, OR MODIFYING THE WALK-IN VOIDS ALL MANUFACTURER'S WARRANTIES. ANY OUTDOOR WALK-IN MUST BE DESIGNED TO MEET STATE & LOCAL SNOW LOAD AND LIVE LOAD REQUIREMENTS.

**IMPORTANT!**  
CARROLL COOLERS MUST KNOW IF YOU ARE USING QUARRY TILE IN THE WALK-IN OR BUTTING UP TO THE WALK-IN. ROUGH OPENINGS FOR PASS THRU DOORS AND CCI DOORS WILL NEED MODIFICATION TO ALLOW THE DOORS TO OPEN AND CLOSE PROPERLY.

UL CLASSIFIED BUILDING UNITS SURFACE BURNING CHARACTERISTICS 4P37	5" THICK MAXIMUM PAINTED OR UNPAINTED FINISHED PANEL	
	CORE MATERIAL	STEEL ALUMINUM
FLAME SPREAD	20	20
SMOKE DEVELOPED	400	OVER 500
		OVER 500

R15578

**NOTICE: CONCRETE AND TILE WORKERS**

\*THE SHEET METAL FACING INSIDE THIS WALK-IN MAY STAIN OR OXIDIZE DUE TO EXCESSIVE MOISTURE CREATED BY HYDRATION OF CONCRETE MATERIALS.

\*EXTRA CARE MUST BE TAKEN WHEN USING MURIATIC ACID OR OTHER HARSH CLEANING MATERIALS.

\*EXTREMELY IMPORTANT TO VENTILATE THE WALK-IN PROPERLY WHILE CONCRETE IS CURING.

**WARNING!**

ENGINEERED FOR ON-GRADE INSTALLATION. IF ANY PORTION OR ALL OF THIS WALK-IN IS TO BE INSTALLED IN A DEPRESSION, CONTACT THE CARROLL COOLERS, INC. SALES DEPT. IMMEDIATELY 1-800-764-6834

WALK-IN COMPLIES WITH ALL PROVISIONS OF SECTION 312 OF THE ENERGY INDEPENDENCE AND SECURITY ACT OF 2007

**CARROLL COOLERS**  
 19705 HIGHWAY 30 WEST; P.O. BOX 671  
 CARROLL, IOWA 51401  
 PHONE (800) 764-6834  
 FAX (712) 792-6748

SALESMAN	APPROVAL DRAWING DATE	5/31/16
	PRODUCTION DRAWING DATE	7/18/16
	TAG NUMBER/FILE NAME	8 x 10 x 8 FZR
	APRV DWG BY	
	PROD DWG BY	
	JOB LOCATION	
	PURCHASE ORDER NUMBER	